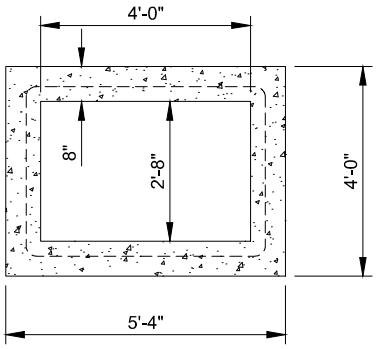

PLAN SECTION

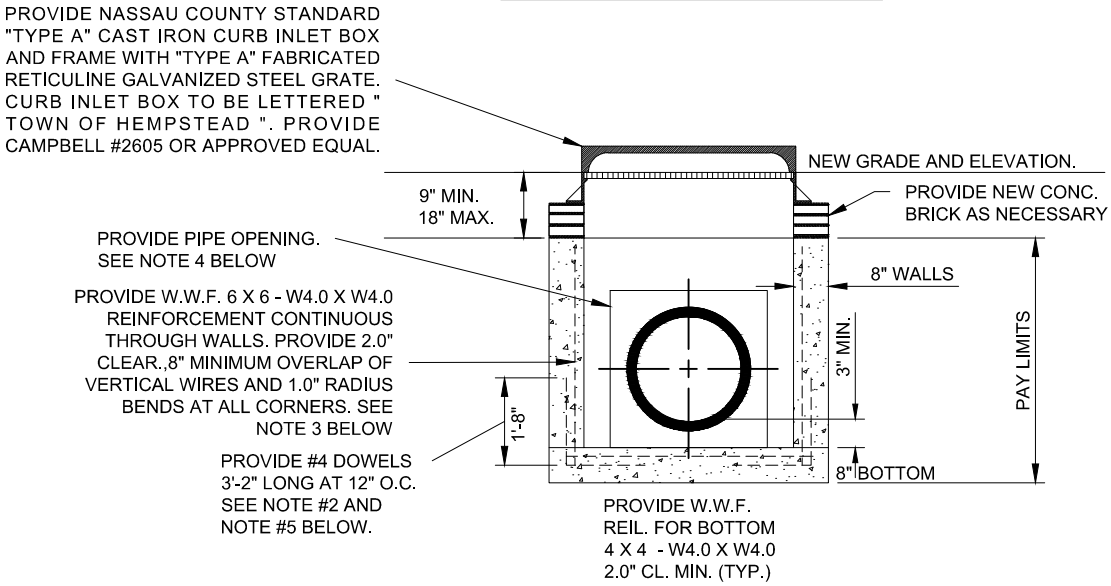

ELEVATION SECTION

TYPE B-MOD NOTES:

1. CONCRETE SHALL BE NYSDOT "CLASS A" DESIGN MIX AND 4000 PSI MINIMUM AT 28 DAYS.
2. REBAR SHALL BE GRADE 60 AND CONFORM TO ASTM A-615
3. WELDED WIRE FABRIC SHALL CONFORM TO ASTM A-185
4. ALL PIPE OPENINGS SHALL BE PRECAST INTO THE NEW STRUCTURE. KNOCKOUT PANELS SHALL NOT BE PERMITTED. PRECAST OPENING SHALL E SQUARE IN SHAPE AND ALLOW FOR PIPE CLEARANCE.

DETAIL OF NEW TYPE "B-MODIFIED" PRECAST CONCRETE CATCH BASIN

ITEM 604.501006

NOT TO SCALE

ADDENDUM No. 2
BID No. 19-05

PREPARED BY

NELSON & POPE
ENGINEERS · SURVEYORS
572 WALT WHITMAN ROAD, MELVILLE, N.Y. 11747-2188
631.427.5665 WWW.NELSONPOPE.COM FAX 631.427.5620

VILLAGE OF AMITYVILLE
21 IRELAND PLACE
AMITYVILLE NY, 11701

Date:	OCT. 2019
Property No.:	18001
Scale:	N.T.S.
Figure:	TYPE - 'B-MOD' CATCH BASIN